



TWIN 54,000 LITRE WATER TANKS

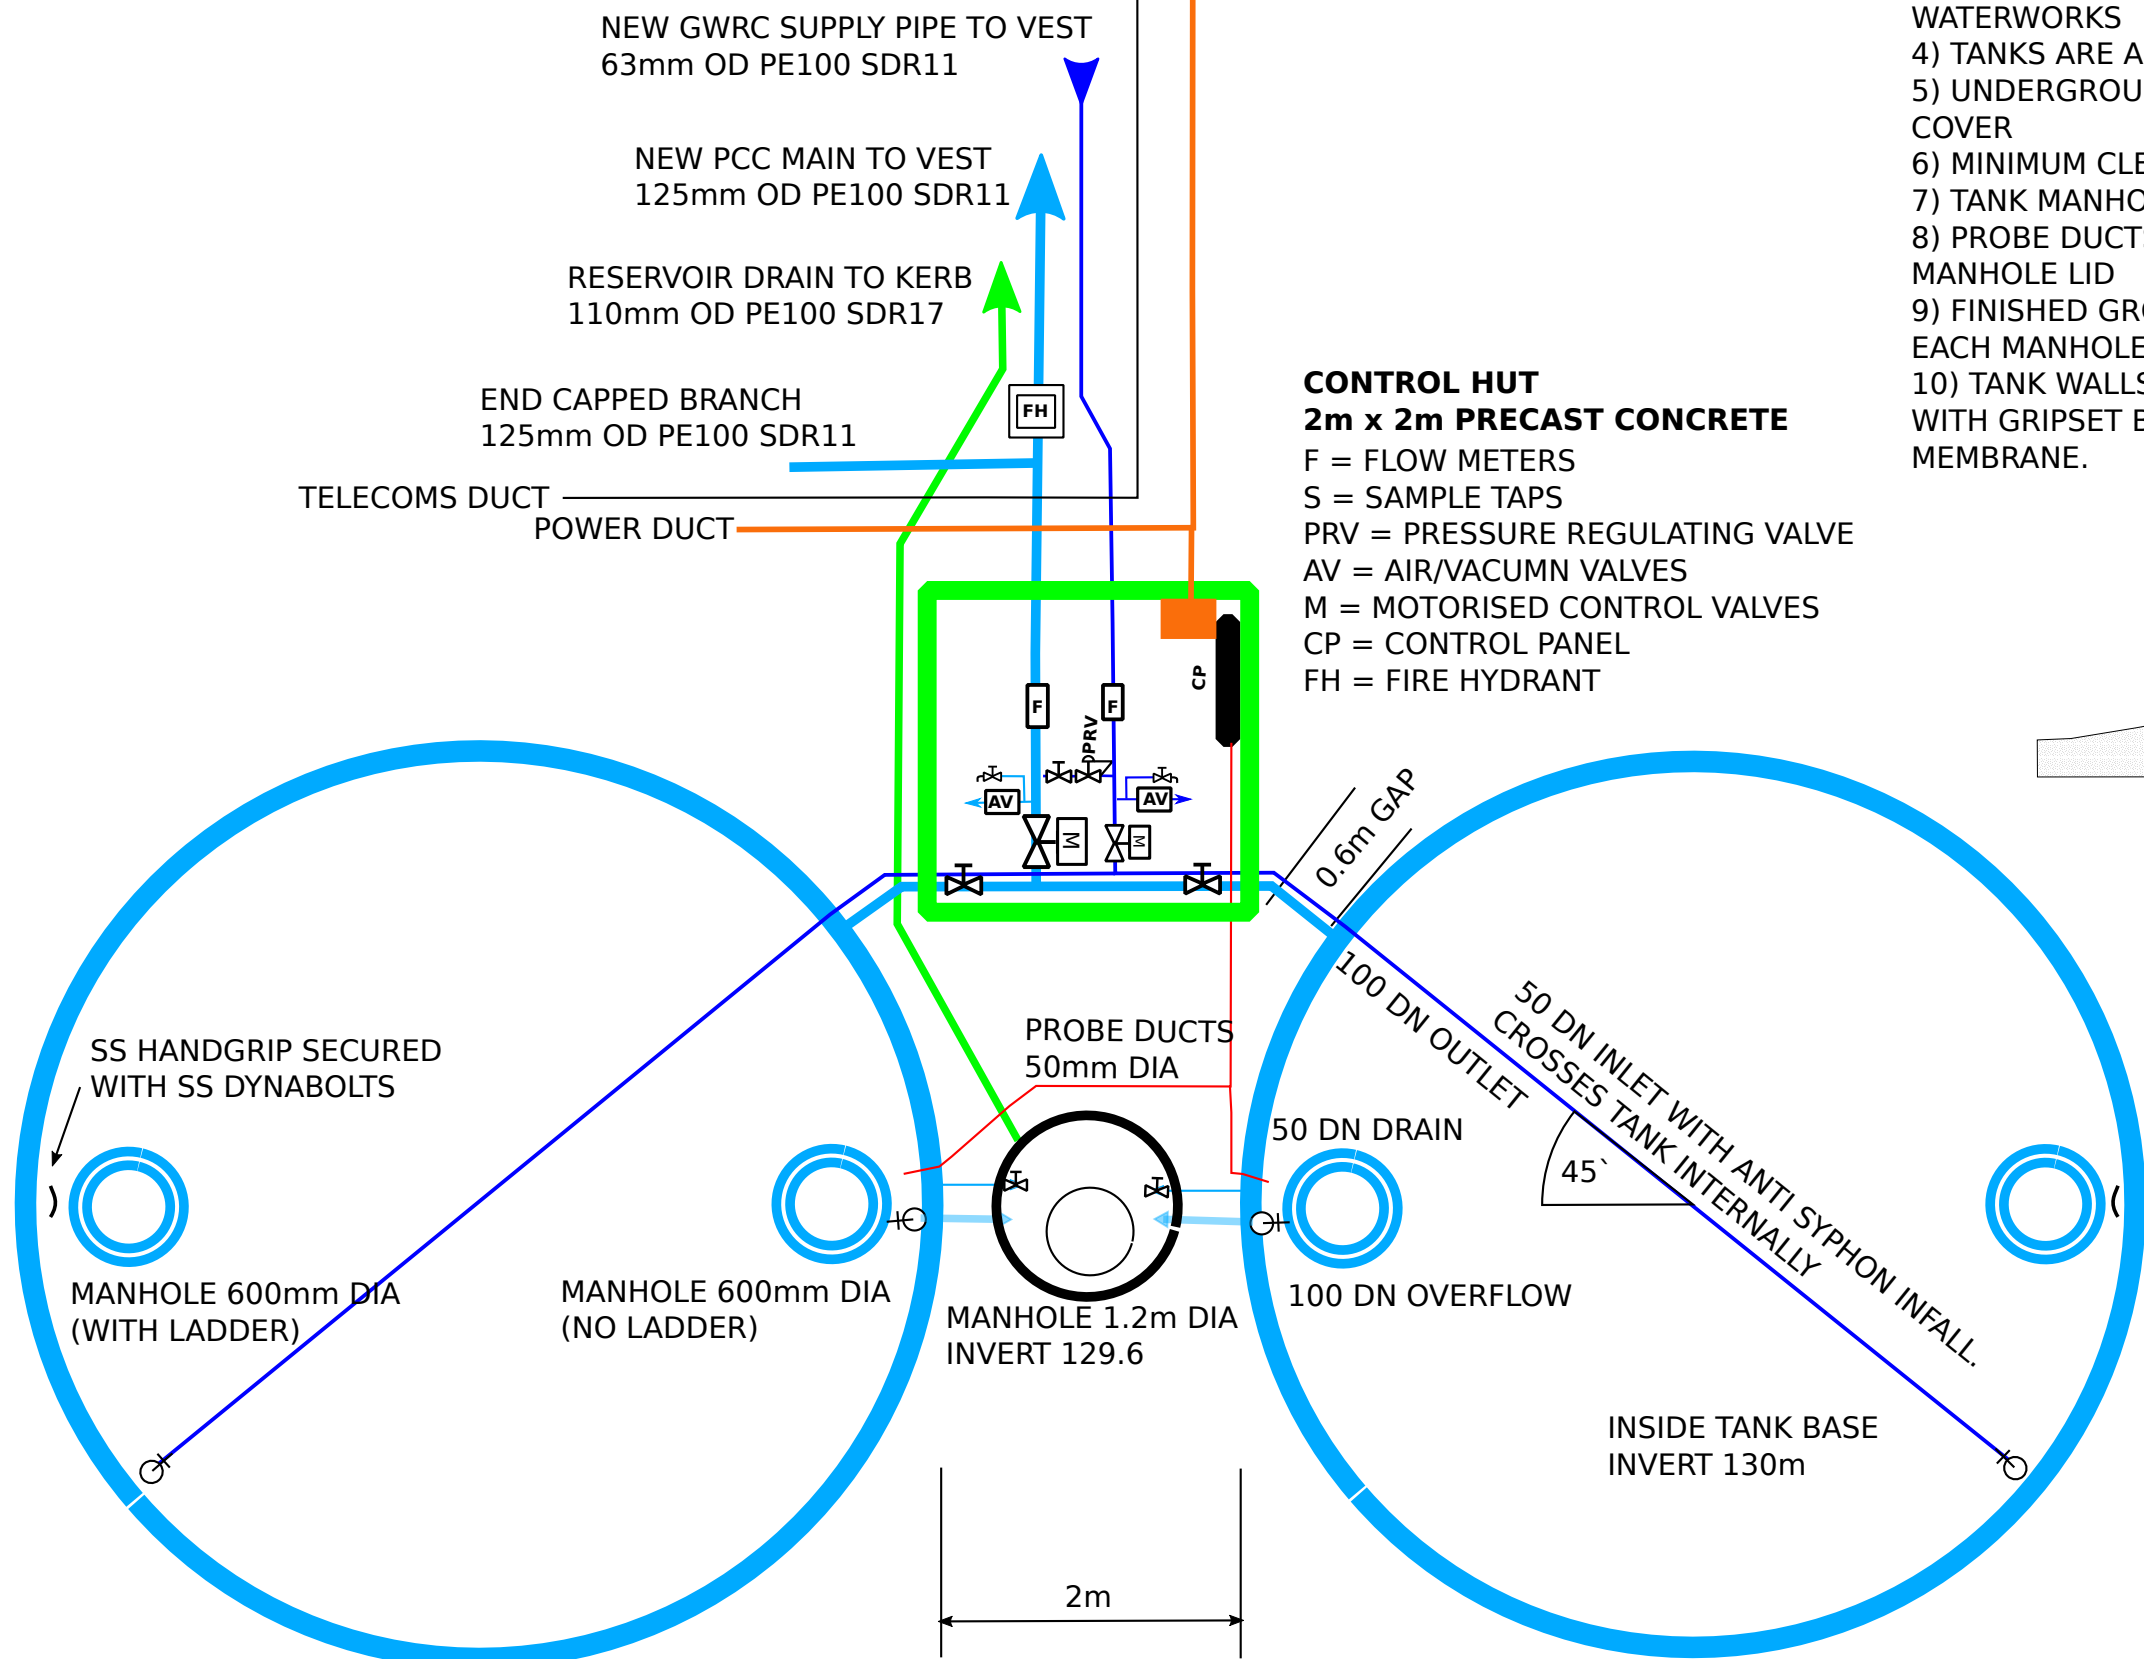

- Notes:
- 1) SEE DRAWING ROSS TANKS A3-S01 TANK DESIGN
 - 2) SEE DRAWING P1.ENG031 TANK PIPE WORK
 - 3) SEE DRAWING P1.ENG032 CONTROL HUT AND WATERWORKS
 - 4) TANKS ARE ARRANGED AS MIRROR IMAGES
 - 5) UNDERGROUND PIPEWORK TO HAVE MINIMUM 750mm COVER
 - 6) MINIMUM CLEARANCE BETWEEN PIPES 200mm
 - 7) TANK MANHOLE LIDS TO BE LOCKABLE
 - 8) PROBE DUCTS ENTER TANKS FROM ABOVE ADJACENT TO MANHOLE LID
 - 9) FINISHED GROUND LEVEL WITHIN 2m EITHER SIDE OF EACH MANHOLE TO BE LESS THAN 1m BELOW ROOF LEVEL
 - 10) TANK WALLS BELOW GROUND LEVEL TO BE PAINTED WITH GRIPSET BETTA BITUMEN RUBBER WATERPROOFING MEMBRANE.

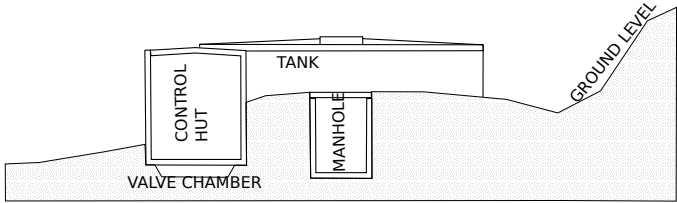

Progeni Ltd

68 Exploration Way,
Whitby,
Porirua 5024
New Zealand

Client	Progeni Ltd
Project	Exploration Heights
Title	Water tank layout

Revisions		Name	Scale	1:50	Size	A3
A			Name	Date	Drawing	
B						
C			Design			
D			Drawn	Harpham		
E			Approved		Revision	