
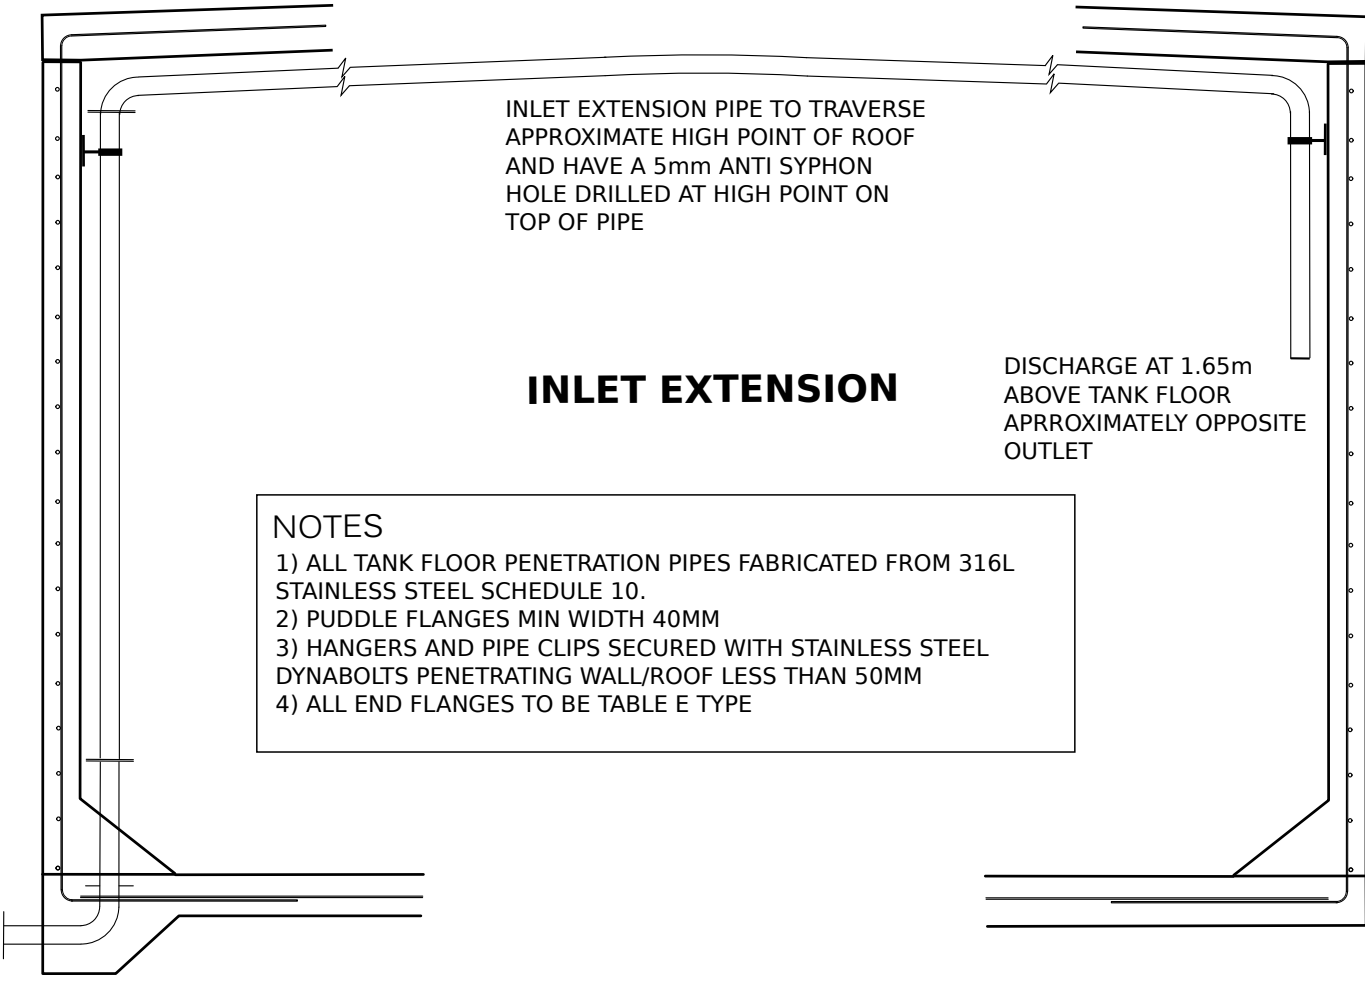
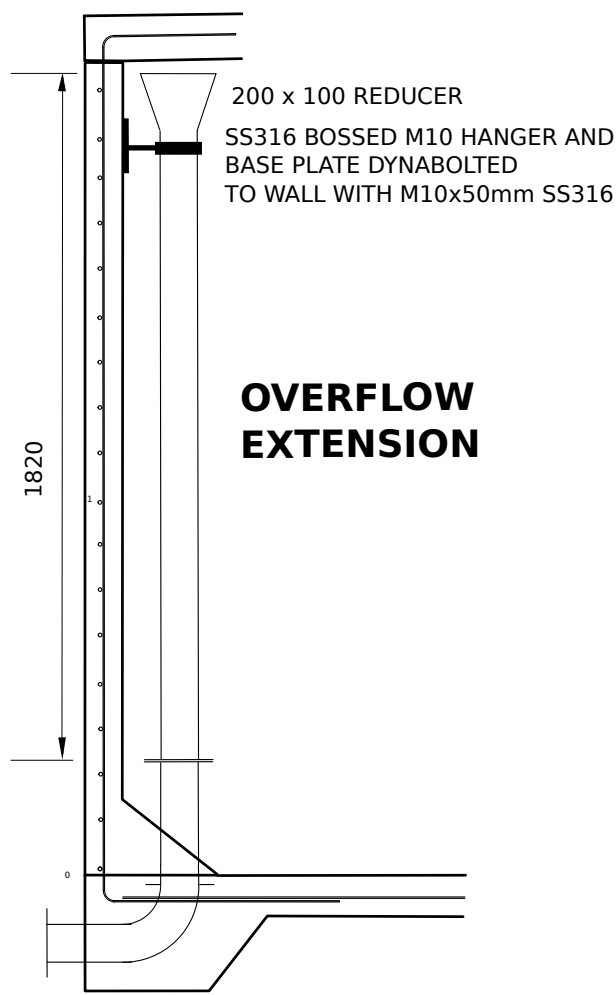
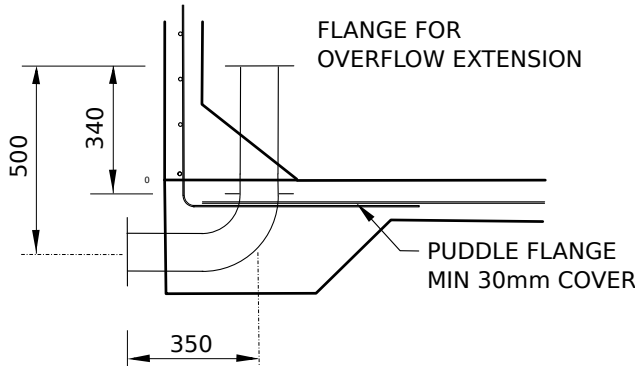
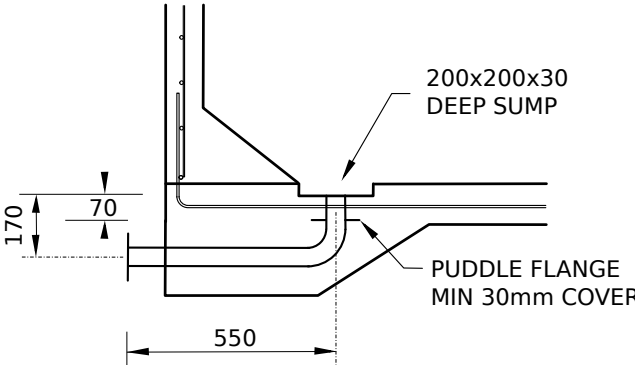
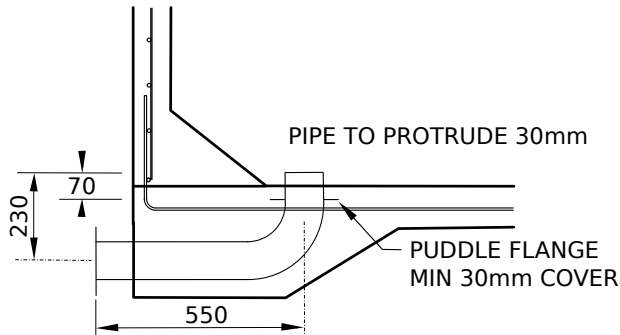


INLET

OUTLET

DRAIN

OVERFLOW

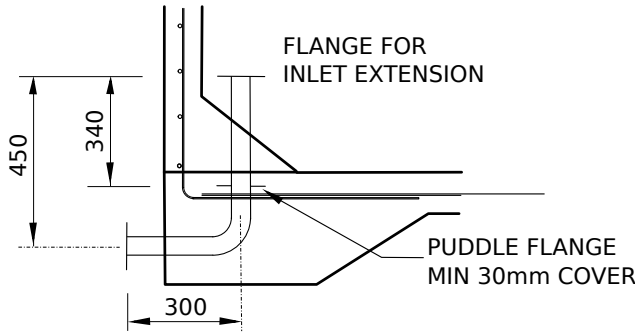

- NOTES**
- 1) ALL TANK FLOOR PENETRATION PIPES FABRICATED FROM 316L STAINLESS STEEL SCHEDULE 10.
 - 2) PUDDLE FLANGES MIN WIDTH 40MM
 - 3) HANGERS AND PIPE CLIPS SECURED WITH STAINLESS STEEL DYNABOLTS PENETRATING WALL/ROOF LESS THAN 50MM
 - 4) ALL END FLANGES TO BE TABLE E TYPE

Progeni Ltd 68 Exploration Way, Porirua 5024, NZ Ph 022 0819600	Client	Progeni Ltd	Fieldwork:		Scale:	1:50 at A1 (1:100 at A3)
	Project	Exploration Heights	Design:		ID:	P1.ENG031 Rev: 2016-04-01
	Title	Tank pipe work	Drawn:	D Harpham	Issued by: D Harpham	
			Checked:		Date: 2016-04-01	